


Key:

1. Proposed tree, refer to planting plan & schedule.
2. 50mm deep Bark Mulch to 1m diameter around base of trees planted in grass areas.
3. 2no. 900mm below ground, 75mm dia pressure treated stakes to be driven into the ground until firm with 600mm above finished ground level. Tie to tree with 3no. rubber tree ties and spacers.
4. Aeration/irrigation pipe, by Green-tech or equal approved. Opening to have proprietary cap.
5. Tree pit to be backfilled with structural tree soil installed in accordance with manufacturers instructions.
6. Refer to Greenhalgh Landscape Architecture Softworks drawing 077-302 for adjacent surfacing.
7. Sides and base of tree pit to be loosened to avoid any smearing and compaction during the excavation. Where pits are located in proximity to existing or proposed services a root barrier should be installed in accordance with the manufacturer's guidance.
8. 300mm medium coarse washed sand.
9. 300mm pea gravel 5-7mm diameter as specified.

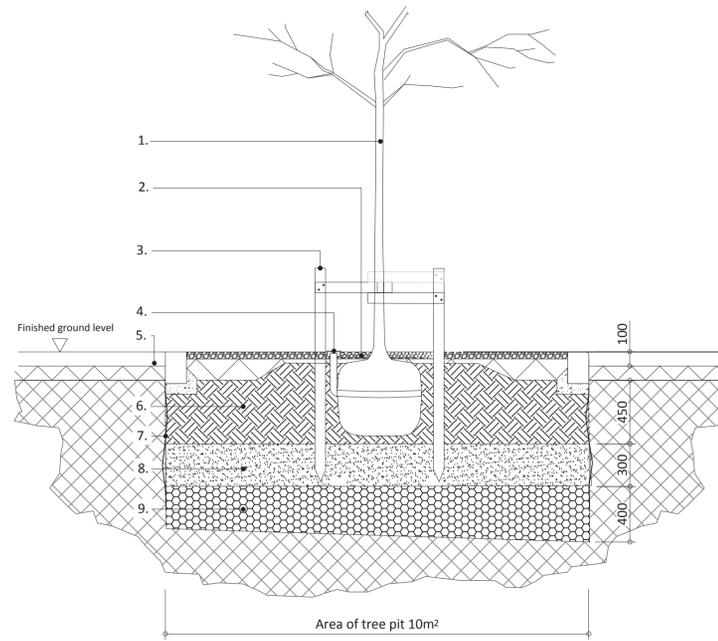

Key:

1. Proposed tree, refer to planting plan & schedule.
2. 50mm depth CEDEC gravel to tree pit.
3. 2no. 900mm below ground, 75mm dia pressure treated stakes to be driven into the ground until firm with 600mm above finished ground level. Tie to tree with 3no. rubber tree ties and spacers.
4. Aeration/irrigation pipe, by Green-tech or equal approved. Opening to have proprietary cap.
5. Refer to Greenhalgh Landscape Architecture Softworks drawings 077-301 and 077-302 for adjacent surfacing.
6. Tree pit to be backfilled with structural tree soil installed in accordance with manufacturers instructions.
7. Sides and base of tree pit to be loosened to avoid any smearing and compaction during the excavation. Where pits are located in proximity to existing or proposed services a root barrier should be installed in accordance with the manufacturer's guidance.
8. 300mm medium coarse washed sand.
9. 300mm pea gravel 5-7mm diameter as specified.

NOTE:

- It is the responsibility of the contractor to ascertain the exact positions of all existing services prior to carrying out landscape works. All drawings to be read in conjunction with the Engineer's drainage, levels and foundation details and specifications where appropriate.
- Final fine grading and levels to be agreed on site with Landscape Architect prior to planting.
- It is the responsibility of the Contractor to ensure tree pits are draining correctly prior to backfilling.
- This drawing assumes that the existing site subsoil and topsoil could be re-used.
- Prior to site wide trenching and excavations, service route position to be sprayed and marked out for Landscape Architect's approval.
- This drawing is protected by copyright. Contractors must check all dimensions on site. Only figure dimensions are to be worked from. Discrepancies must be reported to the landscape architect before proceeding.
7 Sydney Wharf, Bath, BA2 4EF
T: 01225 868432



Rev	Note	Date
P1	For Planning	25.05.2018

GREENHALGH

Landscape Architecture

Thoultstone Eco Leisure Proposal

Tree Pit Details in Hard Landscape

077-405 P1

Date 24.05.2018

Scale 1:25@A1